

Fig. 1

FOR FIG. 1 4829E360

Fig. 2


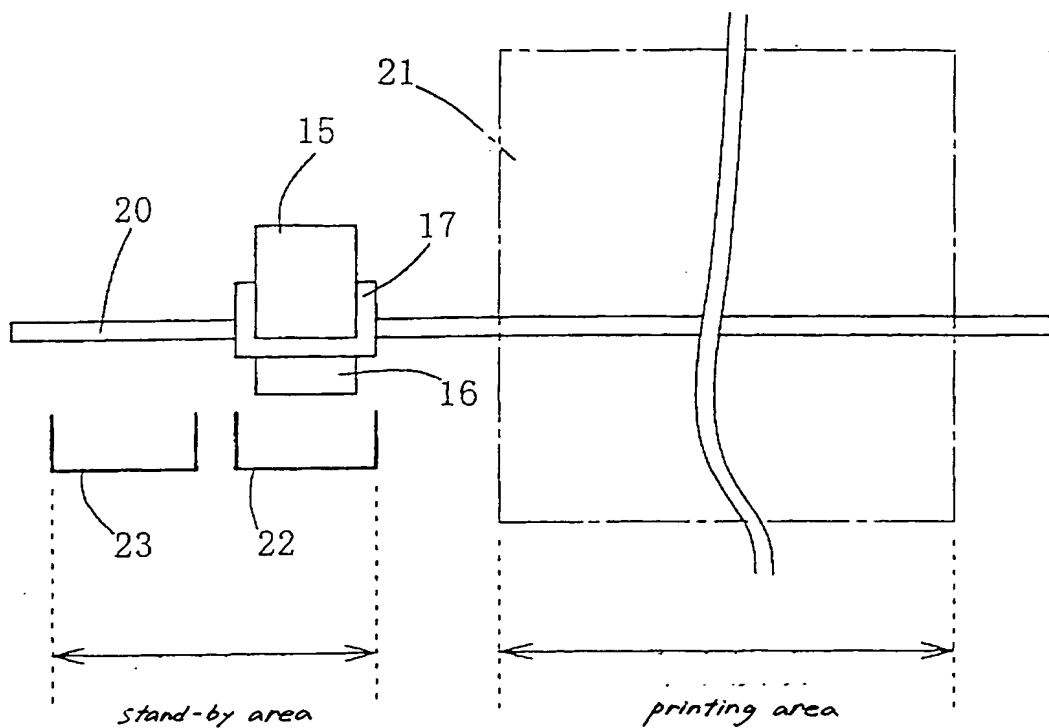


Fig. 3

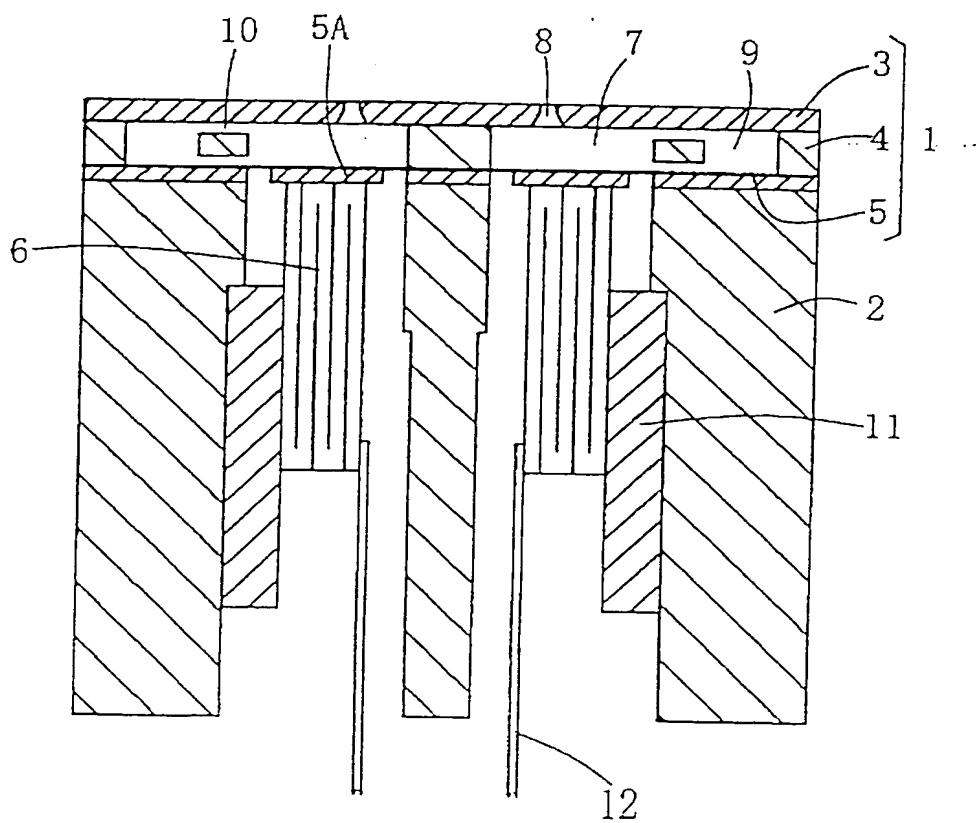

0036284-04301

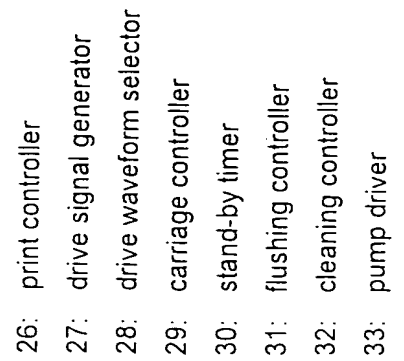


Fig. 5

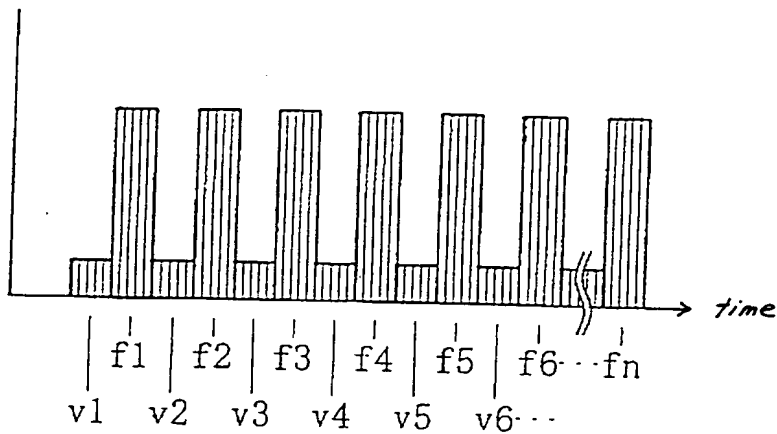


Fig. 6A

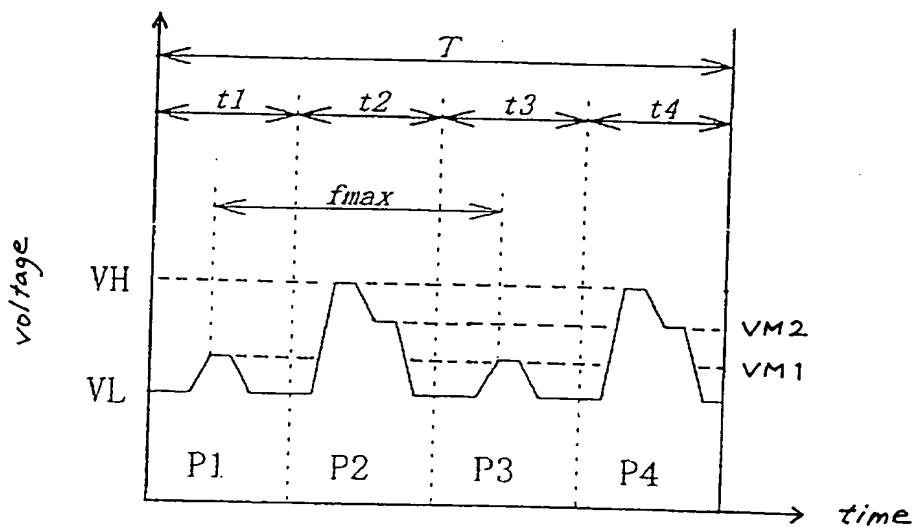


Fig. 6B


	P 1	P 2	P 3	P 4
A	○	—	○	—
B	—	○	—	○

A: meniscus vibrating operation
 B: flushing operation

Fig. 7


A	B	C	
		D	E
0 - 2	100	200	50
2 - 12	1000	400	100
12 -	F		

Fig. 8

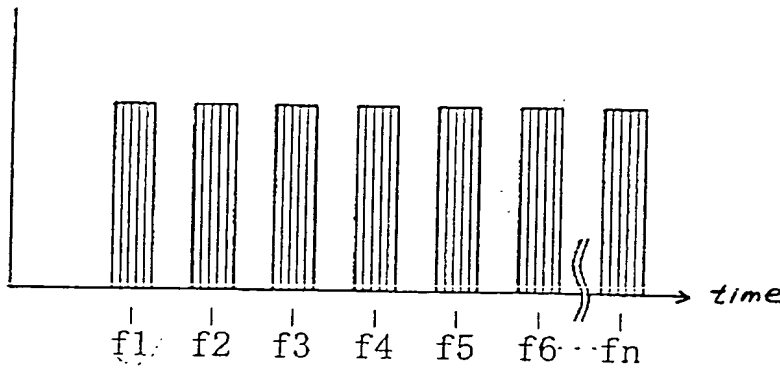

- A: stand-by time period (sec)
- B: vibrating number
- C: flushing number
- D: black ink
- E: color ink
- F: capped stand-by

Fig. 9

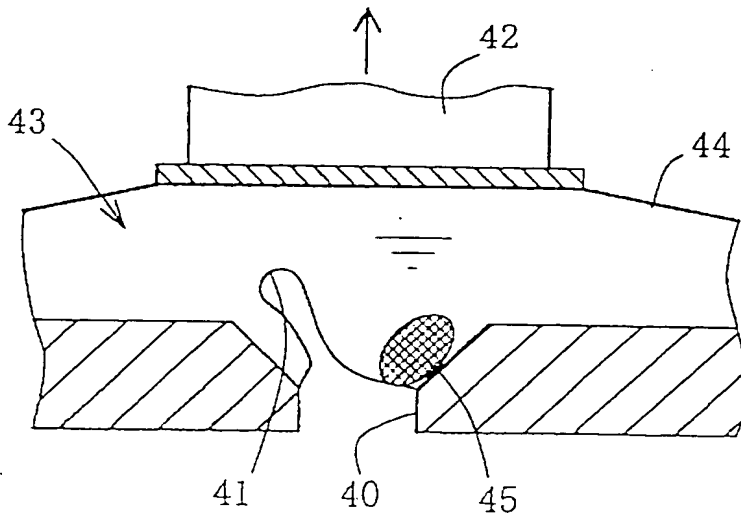

0936284-041801